

Hillsborough County Fire Rescue

Compliant Public Safety In-Building Two-
Way Radio Communications
Enhancement System Requirements

July 13, 2021

Table of Contents

Introduction	2
Summary of Requirements for Owners	3
Occupancies meeting coverage reliability requirements without radio communications enhancement systems:	3
Occupancies requiring radio communications enhancement systems to meet coverage reliability requirements:	4
Initial Determination	5
CERTIFICATE OF RADIO COVERAGE COMPLIANCE	7
<u>Radio Communications Enhancement System Implementation Process</u>	
1. Conduct System Planning and Design.....	8
2. Submit Retransmission Application.....	8
3. Entry in FCC Signal Booster Database.....	8
4. Obtain HCFR Review and HCSO Provisional Retransmission Authorization....	9
5. Perform System Installation	9
6. Perform Pre-Commissioning Activation and Optimization	9
7. Perform Fire Alarm/Two-way Radio Communications Enhancement System Testing.....	9
8. Submit As-Built Documentation	10
9. Issue Certificate of Occupancy	10
10. Annual Testing/Maintenance/Retransmission Agreement Renewal	10
Contractor Qualifications	11
General Scope of Work	12
Electrical power requirements	14
Alarm and Monitoring System	14
Propagation Delay	15
Exterior Antenna System	15
In-Building Antennas	16
<u>Test procedures and measurement parameters</u>	
1. System isolation	16
2. Downlink Signal Strength Measurements	16
3. Uplink	17
4. Defining the test locations as per the size of the building	18
Designer/Contractor Responsibilities	18
Building Owner Responsibilities	19
Sample Provisional Retransmission Authorization	20
Sample Retransmission Application	21
System Technical Data	22
Table 1 - System Frequencies	23
Appendix A – 47CFR90.219, FCC rules governing use of Signal Boosters	25
Appendix B - Article 800 • Communications Circuits 800.179	29
Appendix C - Retransmission Application	34
Appendix D - Provisional Retransmission Authorization	35
Appendix E - Retransmission Authorization	36

Introduction

Hillsborough County Fire Rescue (HCFR) has adopted the current edition of the Florida Fire Prevention Code 7th Edition (Code). The Code requires all new and existing buildings to maintain minimum radio signal strength as determined by the authority having jurisdiction (AHJ) which is HCFR for all unincorporated areas within Hillsborough County (County) FL. Additionally, the Code references NFPA 1221 *Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems, 2016 Edition* as its emergency services communication systems standard. Within NFPA 1221, Chapter 9.6 includes requirements for Two-Way Radio Communications Enhancement Systems.

Modern building design and construction techniques, especially those required to satisfy requirements for LEED-certified building designs, make it difficult or impossible for HCFR to provide reliable two-way radio coverage for first responders operating inside of buildings. Two-way radio communications enhancement systems help ensure the safety of building occupants and first responders by extending the coverage of a public safety communications system to the interior areas of the building through the use of special bi-directional amplifiers (BDAs) and a network of indoor antennas strategically located to provide reliable public safety radio system coverage throughout the interior of a building. The BDA and network of antennas is known collectively as a Distributed Antenna System (DAS).

BDA / DAS systems must be designed, installed, maintained, and repaired by qualified personnel to ensure that they meet the coverage reliability requirements of NFPA 1221 and do not cause unintended harmful interference to the Hillsborough County Sheriff's Office (HCSO) radio systems or other users of the RF spectrum licensed by the Federal Communications Commission (FCC).

The FCC requires that DAS systems be either operated by the licensee of the public safety radio system, or explicitly authorized by the licensee. Additionally, the licensee must enter the DAS into a nationwide registry maintained by the FCC, so the appropriate parties can be contacted should the DAS cause interference to radio systems operated by other licensees.

HCSO operates four (4) radio systems that cover Hillsborough County, a seven (7) site, 20-Channel EDACS 800 MHz Analog/Digital Simulcast Trunked Radio System (EDACS West System), a ten (10) site, 15-Channel EDACS 800 MHz Analog/Digital Simulcast Trunked Radio system (EDACS East System), a nine (9) site, 10-Channel P25 Digital Simulcast Trunked Radio System (P25 East System), and a nine (9) Site , 10- channel P25 Digital Simulcast Trunked radio system (P25 West System) for first responder communications. The HCSO radio shop has responsibility for the day-to-day operation, maintenance, and management of the system.

This document is intended to provide guidance to building owners and developers who are contemplating projects or have existing properties within the County that are required to meet the requirements of NFPA 1221, and to DAS system installation firms operating in the County and installing NFPA 1221 compliant systems to meet the Code requirements.

Summary of Requirements for Owners

When the current code, as adopted by State of Florida, requires reliable in-building public safety radio system coverage, and where necessary, two-way radio communications enhancement systems:

- All commercial, multi-unit residential, governmental, and educational occupancies must have reliable in-building public safety radio communications coverage that meets the requirements of NFPA 1221.

Occupancies meeting coverage reliability requirements without radio communications enhancement systems:

In some occupancies, such as those with smaller footprints or those located in close proximity to one of the HCSO's transmission sites, it may be possible to achieve reliable public safety radio communications coverage throughout the occupancy and meet code requirements without the use of a radio communications enhancement system. Public safety radio coverage in these occupancies must meet the same reliability requirements as those occupancies that require a radio communications enhancement system for all four HCSO radio systems.

- HCFR requires that building owners and developers engage the services of a qualified firm having the knowledge of Radio Frequency (RF) installation with training and experience with two-way radio communication enhanced radio systems in the engineering and design of two-way radio communications enhancement systems to assist with this determination. The system designer (a licensed Professional Engineer, "P.E."), lead installation personnel (factory trained) and personnel conducting radio system tests shall be qualified to perform the work. Design documents and all tests shall be documented and signed by a person in possession of a current FCC General Radio Telephone Operator License and a certificate or certification issued by the:
 - 1. Associated Public Safety Communications Officials International (APCO), or
 - 2. National Association of Business and Education Radio (NABER) or
 - 3. Personal Communications Industry Association (PCIA), or
 - 4. Manufacturer of the equipment being installed.
- Building owners/developers must submit all test documentation and a Certificate of Radio Coverage Compliance ("CORCC"), signed and sealed by the Florida licensed engineer (P.E.) of record, stating that the two public safety radio systems EDACS East System & P25 East System or EDACS West System & P25 West System coverage reliability within the occupancy meets the requirements set forth in NFPA 1221, 9.6, and was tested in accordance with the provisions set forth in NFPA 1221, 9.6.

- The Certificate of Radio Coverage Compliance shall be posted at the fire alarm control panel or at the main electrical panel if no fire alarm control panel is present. An additional copy to be placed in the building manager's office. For buildings not equipped with two-way radio communications enhancement systems, testing for coverage reliability compliance and certification must be performed when all construction and interior finishing work is complete.
- In cases where a radio communications enhancement system is not provided, the indoor public safety radio communications coverage must be certified, signed, and sealed by the Florida licensed engineer (P.E.) of record, as meeting the requirements set forth in the following NFPA 1221 sections, incorporated herein by reference and submit a CORCC stamped by a Florida licensed P.E. with representative screen shots of readings taken in the lowest level of the stairwells:
 - NFPA 9.6.7 Radio Coverage
 - NFPA 9.6.8 Signal Strength
 - Chapter 11 - Testing
 - 11.3.9 Testing of existing Two-Way Radio Communications Enhancement Systems

Occupancies requiring radio communications enhancement systems to meet coverage reliability requirements:

In occupancies where two-way radio communications enhancement systems are required in order to meet code requirements, two-way radio communications enhancement systems and related equipment must meet all NFPA 1221 requirements and additional requirements described in this document:

- Building owners/developers must apply for and obtain a Provisional Retransmission Authorization from HCSO prior to commissioning the two-way radio communications enhancement system. The Retransmission Authorization is required by the FCC and is the system operator's proof that the HCSO has granted permission to operate equipment that uses radio frequencies licensed to the HCSO¹. Provisional Retransmission Authorizations are issued for initial system activation, optimization and testing. Final (5 year) Retransmission Authorizations are issued upon successful commissioning of the system and are valid for a period of five years from date of issuance.
- Equipment used by the two-way radio communications enhancement system must be the type accepted by the FCC.

¹ See 47CFR90.219(b)(1)(i)

- The two-way radio communications enhancement system must be operated in accordance with FCC rules and regulations at all times.
- The two-way radio communications enhancement system shall not cause interference to the HCSO's radio systems or equipment, or to systems or equipment operated by any other FCC licensee.
- Building owners/developers must submit as-built documentation, including the CORCC, in soft copy format (example .pdf) to HCFR & HCSO after testing is completed.
- The in-building radio system shall be capable of modification or expansion in the event frequency changes are required by Hillsborough County Fire Rescue HCFR &/or Hillsborough County Sheriff's Office HCSO, the FCC, another federal agency, or in the case that additional frequencies are allocated to HCSO and/or HCFR. In particular, the in-building radio system shall be expandable to operate on the First Net 700 MHz National Public Safety Broadband Network frequencies 758-768/ 788-798 MHz upon notification by the City of Tampa.

Initial Determination

- In all new buildings and existing buildings being modified, the minimum radio signal strength must be provided. An applicant submits building plans to Hillsborough County Development Services for review.
- In the case of existing buildings meeting the threshold criteria listed below, the owner/occupant shall have the structure surveyed to determine if the radio signal strength meets the requirements within this document.
 - The structure is three (3) stories or more in height.
 - The total building area is 30,000 square feet or more.
 - Any structure classified as Type I or II per the Florida Building Code and is 10,000 square feet or more.
 - Any basement or level below grade plane.

If the structure is deemed compliant then a CORCC shall be submitted to HCFR. If the structure is not compliant, then the owner/occupant shall apply for a BDA/DAS permit through Hillsborough County Development Services.

- Plan review staff includes a plan comment as part of the building permit review stating that compliant public safety radio coverage is required for the occupancy, including the installation of a two-way radio communication enhancement system if necessary, to meet code requirements.
- The applicant proceeds with the **Radio Communications Enhancement System Implementation Process** described below.

In certain occupancies, such as those with smaller footprints or those located in close proximity to one of the HCSO's transmission sites, it may be possible to achieve reliable public safety radio communications coverage throughout the occupancy and meet code requirements without the use of a radio communications enhancement system. Public safety radio coverage in these occupancies must meet the same reliability requirements as those occupancies that require radio communications enhancement system for East EDACS & East P25 or West EDACS & West P25 HCSO public safety communication systems.

- The applicant engages the services of a qualified firm having the knowledge of the HCFR requirements, RF installations with training and experience with two-way radio communication enhanced radio system integrations and installations to assess available radio coverage for both East EDACS & East P25 Systems or both West EDACS & West P25 Systems as applicable on HCSO public safety communications systems at the location of the occupancy and determine if public safety radio coverage reliability in the occupancy will meet code requirements after it is fully constructed and finished, without the use of a two-way radio communications enhancement system.
- Once construction is complete, and prior to occupancy, owners/developers must submit all test documentation and a Certificate of Radio Coverage Compliance, signed and sealed by the engineer of record to the Fire Marshal's Office, stating that the public safety radio system coverage reliability within the occupancy was tested in accordance with the provisions set forth in NFPA 1221.
- The Certificate of Radio Coverage Compliance shall be posted at the fire alarm control panel or at the main electrical panel if no fire alarm control panel is present. An additional copy to be placed in the building manager's office.
- **If testing determines that public safety coverage reliability does not meet code requirements for either East EDACS & East P25 Systems or West EDACS & West P25 Systems on HCSO public safety communication systems, a compliant radio communications enhancement system must be installed and tested prior to issuance of the certificate of occupancy.**

Hillsborough County Fire Rescue Fire Marshal's Office

CERTIFICATE OF RADIO COVERAGE COMPLIANCE

PROJECT NAME: _____

PROJECT ADDRESS: _____

DESIGN PROFESSIONAL ENGINEER OF RECORD: _____

TEST DATE AND TIME: _____

(Testing for compliance and certification shall be performed after construction and interior finishing work is complete)

Check one:

- ☐ I certify that the occupancy identified above was tested for Hillsborough County Sheriff's Office two systems
() East 700MHz & 800MHz or () West 700MHz & 800MHz public safety radio systems radio RF coverage levels and meets the requirements set forth in NFPA 1221 without the use of a Two-Way Radio Communications Enhancement System.
- ☐ I certify that the building was tested in accordance with the provisions set forth in NFPA 1221. To the best of my knowledge, information and belief, the radio RF coverage levels for this occupancy meet or exceed those required by NFPA 1221.

Professional Certification: I hereby certify that these documents were prepared or approved by me, and I am a duly licensed Professional Engineer under the laws of the State of Florida,

License Number _____, Expiration Date: _____.

Respectfully submitted,

Signature and Seal of Design Professional Engineer of Record

Date

Radio Communications Enhancement System Implementation Process

HCFR has defined the following process for owners or developers planning new occupancies or modifications to existing occupancies that require a radio communications enhancement system to ensure operation of either East EDACS & East P25 or West EDACS & West P25 HCSO public safety communication systems inside buildings as applicable.

1. Conduct System Planning and Design

The applicant includes an NFPA 1221 compliant two-way radio communications enhancement system in the design requirements for the project. A qualified integrator or installation firm is hired to design, install, test, and activate the two-way radio communications enhancement system as a part of the building project. HCSO aids the integrator/installer in directing the selection of the donor sites for the proposed two-way radio communications enhancement system for either East EDACS & East P25 or West EDACS & West P25 HCSO public safety communication systems.

The applicant must obtain a separate low-voltage permit at Hillsborough County Development Services to cover the installation of the two-way radio communication enhancement system. Note: The fire alarm contractor is responsible for the fire alarm permit application, and integration of the radio communications enhancement system into the fire alarm supervisory notification/alarm panel.

2. Submit Retransmission Application

Integrator/installer completes a Retransmission Application for each BDA headend in the system design. Retransmission Applications must include the Low Voltage Permit Number assigned for the work. Owner submits Retransmission Application(s) and proposed design documentation (system design diagrams, bill of materials (including specification sheets) and floor plan diagrams) to Development Services for fire review.

3. Entry in FCC Signal Booster Database

BDA/DAS system owners are required by the FCC to register their BDA/DAS system (which the FCC identifies as 'signal boosters') with the FCC. This applies to those systems already placed in operation, in permitting or under construction. The FCC Rule requiring registration is CFR 47, FCC Part 90.219(d) (5). Additional information may be found at:

<http://wireless.fcc.gov/signal-boosters/part-90-boosters/index.html>

A copy of this registration shall be submitted to the Fire Marshal's Office for inclusion in building attributes.

4. Obtain HCFR Review and HCSO Provisional Retransmission Authorization

HCFR conducts a technical review of the proposed design. Upon approval of the design, HCFR will notify HCSO to issue signed Provisional Retransmission Authorization to applicant, which authorizes operation of the system for the purposes of installation, testing, and optimization. The Provisional Retransmission Authorization is valid for a period of one year from date of issuance.

5. Perform System Installation

The integrator/installer proceeds with installation of the approved system(s) in accordance with the project's plan and schedule. Substantial design changes from those specified in the initial design must be approved by HCFR (e.g., selection of a different donor site, selection of different model BDA, selection of a different donor antenna, additions or changes to number of line amplifiers in the design, and changes to equipment room location in building).

Updated HCFR review and approval is not required for minor changes that do not impact the number of active amplification devices used by the system or impact the donor site (e.g., changes to the number or location of indoor coverage antennas in the design).

The two-way radio communication enhancement system should not be activated for optimization and testing without prior HCSO approval. HCSO staff may, at their sole discretion, require that an initial desense test be conducted prior to initial activation to ensure that no harmful interference occurs to any of the the four (4) HCSO's radio systems, West EDACS & West P25 Systems or East EDACS & East P25 Systems as applicable.

Integration with supervisory notification/alarm panel(s) must be compliant with the requirements of NFPA 72 and must be completed prior to fire alarm and two-way radio communication enhancement system testing.

6. Perform Pre-Commissioning Activation and Optimization

DAS Integrator/installer posts the Provisional Retransmission Authorization at the headend location(s). The integrator/installer notifies HCSO staff when ready to activate the system for the first time.

If required by HCSO, an initial desense test is coordinated for the first activation of the system. The integrator/installer conducts system activation and optimization.

7. Perform Fire Alarm/Two-way Radio Communications Enhancement System Testing

The DAS integrator/installer coordinates scheduling of system testing with the fire alarm contractor at the site. Testing shall include integrator/installer staff, fire alarm contractor staff, and Fire Marshal's Office staff.

The test participants conduct NFPA 1221 compliant coverage testing and supervisory notification/alarm panel testing on the scheduled date.

8. Submit As-Built Documentation

The DAS integrator/installer provides test results and full system as-built documentation to HCFR & HCSO in soft copy (e.g., PDF) format. HCSO issues a Final Retransmission Authorization valid for a period of five years from date of issuance. The Final Retransmission Authorization must be posted at all headend location(s). HCFR adds the as-built documentation to the building attributes.

9. Issue Certificate of Occupancy

After all requirements for occupancy are met, including successful testing of the two-way communications enhancement system, supervisory notification/alarm panel interface and donor site desense, receipt of required documentation, and posting of Final Retransmission Authorization(s) at the system headend(s). An additional copy to be placed in the building manager's office, the Fire Marshal issues a Certificate of Occupancy.

10. Annual Testing/Maintenance/Retransmission Agreement Renewal

The building owner retains services of a qualified firm having the knowledge of RF installation with training and experience with two-way radio communication enhanced radio systems to ensure that the original installed system is still in compliance, to conduct annual preventive maintenance and assist with annual testing.

The building owner coordinates annual testing of the two-way radio communications enhancement system with annual testing of other fire alarm and fire safety systems. Annual testing of two-way radio communications enhancement systems shall be performed in accordance with the requirements of NFPA 1221.

Final Retransmission Authorizations are valid for five years from date of issuance and must be retested annually. To renew, submit current (within 30 days) annual test documentation and application for Retransmission Authorization renewal to HCSO electronically at:

smitchell@teamhcsso.com

cbadr@teamhcsso.com

HCSO will issue a new Retransmission Authorization valid for a period of five years from date of issuance after all of the required documents have been submitted and reviewed.

Contractor Qualifications

The Contractor shall be able to demonstrate previous experience in deployments of in-building RF radio coverage solutions for Public Safety systems, specifically in the following frequency bands: 700 MHz and 800 MHz

To ensure personnel safety, all construction tasks shall be conducted in accordance with OSHA safety and/or local safety regulations (whichever is more stringent). Contractors must comply with applicable Federal, State and Local Codes and requirements, including the Florida Building Code. All site development and equipment installation work shall comply with all applicable codes in use by Hillsborough County. Government and local codes shall take precedence over the requirements of this document provided they offer added safety.

The system designer must be a Florida licensed Professional Engineer (P.E.), lead installation personnel and personnel conducting radio system tests shall be qualified to perform the work. **Design documents and all tests shall be documented and signed by a person in possession of a current FCC General Radio license or certification issued by the:**

- Associated Public Safety Communications Officials International (APCO), or
- National Association of Business and Education Radio (NABER) or
- Personal Communications Industry Association (PCIA), or
- Manufacturer of the equipment being installed.

Contractor must be knowledgeable and adhere to the latest versions and amendments of the following industry standards and codes:

- Florida Fire Prevention Code, 7th Edition
- NFPA 70, 2017 National Fire Protection Code or “National Electrical Code”
- NFPA 72, 2016 National Fire Alarm and Signaling Code
- NFPA 780, 2014 “Standard for the Installation of Lightning Protection Systems”
- NFPA 1221, 2016 “Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems”
- Harris, “Site Grounding and Lightning Protection Guidelines”
- Motorola R-56, “Standards and Guidelines for Communication Sites”
- TIA Bulletin TSB-88.1-C, Wireless Communications Systems Performance in Noise-Limited Situations, Part 1: Recommended Methods for Technology-Independent Performance Modeling
- Florida Building Code

- ANSI/TIA-222-H, Structural Standard for Antenna Supporting Structures and Antennas
- IEEE STD 142 “Green Book”, “Recommended Practice for Grounding of Industrial and Commercial Power Systems”
- ANSI/TIA/EIA-568-D, “Commercial Building Telecommunications Cabling Standard
- ANSI/TIA/EIA-569-E, “Commercial Building Standards for Telecommunications Pathways and Spaces”
- ANSI/TIA/EIA-606-C, “The Administration Standard for the Telecommunications Infrastructure of Commercial Building”
- ANSI/TIA/EIA-607-C, “Commercial Building Grounding and Bonding Requirements for Telecommunications”

All other applicable Federal, State and Local Building Codes and Requirements

General Scope of Work

The DAS Integrator Designer/Installer shall provide a “turn-key” solution for the design, installation and testing of an in-building RF coverage system capable of meeting the requirements detailed in this document.

Should the contractor of record fail to have radio RF communications installation and repair experience with Distributed Antenna Systems, the contractor of record shall sub-contract the installation or repair of non-fire alarm function to a qualified company, having knowledge of Radio RF communications installation and repair.

For the downlink signal, a minimum signal strength of negative (-) 95 dBm throughout the entire facility with a Delivered Audio Quality (DAQ) of 3.4 or better, is required 100 % of the time.

For General Structure Areas, the in-building RF solution shall provide the above-specified coverage in 90% of the floor area as directed in this document and NFPA 1221. General Structure Areas are defined as living areas, basements, parking garages, administrative offices, and conference rooms.

For Critical Areas, the in-building RF solution shall provide the above-specified coverage in 99% of the floor area. Critical Areas are defined as fire command centers, mechanical and utility rooms, public bathrooms, “Employee Only” access areas, stairwells, exit stairs, exit passageways, Police holding areas, elevator lobbies, fire pump rooms, sprinkler sectional valve locations, and other areas considered by

HCFR. The Designer/Installer shall contact HCFR to confirm critical areas in the new construction.

The system shall provide the required coverage in the frequency bands or channels specified by HCFR.

The in-building RF Public Safety radio coverage system and other radio systems operating within (or in the vicinity of) the facility shall not interfere with each other.

BDA Information

The in-building radio system shall use a channelized BDA (one 12.5 kHz filter per frequency. The BDA shall be certified Class "A" FCC-type accepted and must operate in accordance with FCC rules. The system must also be compatible and fully operational with both P25 Phase 1 and P25 phase 2 for all West EDACS and P25 West channels or all East EDACS & P25 East Channels as applicable.

The BDA shall also provide a squelch capability for uplink. Some BDAs meet the requirements only when the relevant features are configured appropriately, so the vendor will ensure that it is the case. More than one BDA maybe coupled to support the two systems and frequencies.

The selected BDA shall be capable of "AGC Overdrive" and "Oscillation Control" features. This includes, but is not limited to, an alarm and automatic shutdown for oscillating amplifiers.

Signal boosters shall be a Class A; FCC-type accepted and must operate in accordance with FCC rules.


The signal booster shall be installed in a fire engine-red NEMA 4 (or 4X) enclosure with locking mechanism with 2" high contrasting letters. Include the following information:

- a) Fire Department Signal Booster
- b) Permit Number: _____
- c) Serviced by: Vendor name and telephone

Maximum VSWR measured in any RF branch of the DAS shall not exceed 1.5:1 (14 dB Return Loss).

Buildings equipped with an Emergency Responder Radio Coverage system shall be identified by a sign located on or near the Fire Alarm Control Panel stating: "This building is equipped with an Emergency Responder Radio Coverage System." As a general rule, fire protection and related equipment are identified by a red sign with minimum one-inch white letters as shown below.

Example:

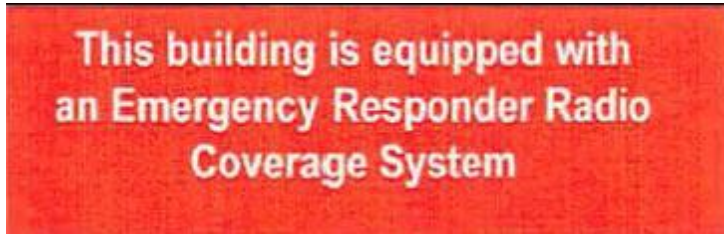

Electrical power requirements

All active components of the DAS shall be powered from an emergency power source via dedicated ("home run"). In addition, twelve-hour battery backup for the in-building system operating at 100% capacity is required.

NEMA twist-lock electrical plug and receptacle set shall be utilized to connect the active components of the DAS to the AC power.

Surge protection device(s) shall be used to protect active components of the DAS from electrical transients.

Alarm and Monitoring System

An automatic monitoring system is required with a dedicated panel in the administrative office of the building (or other location to be agreed) so the system can be constantly monitored.

The system must monitor and produce an alarm in the event of antenna system malfunction or signal booster failure. Additionally, in case that an in-building solution based on RF/Fiber Optics converters is selected, the system shall also be capable of alarming in the event of malfunction of the main and the expansion hubs.

A separate alarm for oscillating amplifiers is also required. The selected signal booster shall be capable of "AGC Overdrive" and "Oscillation Control" features. This includes, but is not limited to, an alarm and automatic shutdown for oscillating amplifiers. These features are intended to minimize interference due to oscillation of the signal booster(s).

Power supplies must, at a minimum, alarm at loss of ac power, failure of the battery charger, and low battery charge (defined as 70% of capacity).

Propagation Delay

The maximum radio signal propagation delay introduced by the in-building coverage solution shall not exceed 8 μ s. If a delay greater than 8 μ s is expected by design, then further analysis should be conducted in conjunction with the HCSO to evaluate potential signal degradation in areas where the direct signal coming from a radio site coincides with the DAS output signal.

Exterior Antenna System

The orientation of the donor antenna shall be determined in coordination with the HCSO.

If required by FAA regulations, obstruction lighting and/or marking shall be installed.

All exterior antennas are to be narrowband, high-gain, vertically polarized and designed for the specified frequency band. Yagi or corner reflector-type antennas are recommended.

All exterior mount antennas must be rated for 160 MPH wind gusts or higher.

The antenna installation, including the shield of the coaxial cable shall be suitably connected to the building's electrical ground system at the base of the antenna mast and at a coaxial lightning protector as per Motorola R56 and Harris Site Grounding and Lightning Protection Guidelines.

A weatherized coaxial lightning protector designed for the proper frequency band shall be installed in the coaxial cable feed outside the facility.

Typical requirements for coaxial lightning protectors are the following:

- Impedance: 50 Ω
- Frequency range: as needed to the respective bands
- VSWR: 1.1:1 or better
- Insertion Loss: 0.1 dB or better
- Impulse Discharge Current : 10KA or better
- Turn-on voltage: 600 V
- Turn-on Time: 2.5 nS for 2kV/nS
- Energy Throughput Rating: 5 nJoule for 3 kA (8/20 μ S waveform)

- Continuous handling RF power: 100 W or better at the respective frequency bands
- Rated for 160 MPH wind gusts or higher

A rooftop donor antenna installation shall meet the wind loading requirements of the Florida Building Code and ANSI/TIA-222-G.

In-Building Antennas

The in-building antenna system shall consist of a sufficient number of antennas, distributed in a wise manner within the building to meet the coverage criteria previously specified and not excessively penetrate outside of the building.

Future Expansion and Modifications

The in-building radio system shall be capable of modification or expansion in the event frequency changes are required by the HCSO, Hillsborough County Sheriff's Office, the FCC, another federal agency, or in the case that additional frequencies are allocated to the HCFR/or HCSO. In particular, the in-building radio system shall be expandable to operate on the FirstNet 700 MHz National Public Safety Broadband Network frequencies 758-768/ 788-798 MHz upon notification by the HCFR &/or HCSO.

Test procedures and measurement parameters

1. System isolation

- a) Once the DAS is deployed, and before turning up the active components of the DAS, the very first test the Contractor shall perform is to verify that the isolation between the donor and the in-door antenna systems is at least 15 dB greater than the gain of the DAS.

2. Downlink Signal Strength Measurements

- a) Downlink signal levels shall be measured to ensure the system meets the requirements of a minimum RF signal level of -95 dBm and 3.4 DAQ or better, throughout the entire facility and attached structures under the conditions described in this document, 100% of the time.
- b) With the purpose of (to some degree) accounting for the signal fading, two (2) readings of signal strength per tile should be taken within intervals of 20 seconds each.

- c) The first 20-second reading shall be performed to determine the maximum peak hold of the test channel. The second reading shall be performed to determine the minimum peak hold of the test channel. The average of both readings per tile should then be calculated.
- d) If the signal readings are conducted using a unity-gain antenna attached to a professional spectrum analyzer and considering the signal attenuation due to “body effect”, the average pick levels previously obtained is an indication reasonably good of the received channel power under fading conditions in each tile. Received channel power is precisely what should be determined during the baseline study to verify the need for a DAS in the facility under study.
- e) For the benchmarking of the facility, the Contractor shall reflect in appropriate floor plan(s) the maximum and minimum pick hold readings obtained at each test point. For the final report or As-built documentation, the Vendor should develop floor plans showing “before” and “after” measurements of the maximum and minimum pick hold readings.

Contractor shall provide a floor plan heat map that color codes the received levels (the map needs to demonstrate that all floors, stairwells elevators have been tested exhaustively).

3. Uplink

- a) Testing the uplink signal of a DAS is a difficult task for the Contractor since it would imply conducting measurements directly in the infrastructure of the Public Safety radio system.
- b) Calculations of the link budget may be used to estimate the necessary gain in the uplink to produce a signal strength of -95 dBm at the donor site. However, as a rule of thumb it is advisable to set up the uplink gain of the DAS at values ranging between 10-20 dB less than the downlink gain, depending on the distance to the donor site.
- c) It is advisable that the test procedures be conducted considering the following:
 - Size of the building
 - Classification of the area under test (General Structure or Critical Area)

4. Defining the test locations as per the size of the building

- a) For small commercial buildings (single story, open floor plan), it is advisable to define five (5) tests locations, one at each corner and one in the center of the building, on each floor.
- b) For medium buildings (small school, light industrial, medical office), it is advisable to test along the core and at each corner of the building, and then at a maximum of 25 ft. intervals in-between the previously defined points whenever possible, in a grid pattern, at each floor.
- c) For large buildings (shopping malls, factories, buildings above 5 stories), it is advisable to test along the core and at each corner of the building, and then at a maximum of 50 ft. intervals in-between the previously defined points whenever possible, in a grid pattern, at each floor.
- d) For small commercial buildings, due to the small quantity of readings to be taken, no “Fail” conditions should be allowed. Therefore 100% of the floor area shall show -95 dbm or better signal strength.
- e) For medium and large buildings, 90% and 99% of the readings should show -95 dBm or better for General Structure and Critical Areas, respectively per floor.
- f) In all cases, the signal strength measurements should be reflected on a building floor plan to show “Before and After” measurements.

Contractor shall provide a floor plan heat map that color codes the received levels (the map needs to demonstrate that all floors, stairwells elevators have been tested exhaustively).

Designer/Contractor Responsibilities

- Survey the facility to demonstrate the necessity of an in-building RF solution in the new building and submit benchmarking results and corresponding Scope of Work to Hillsborough County.
- Design, commissioning and testing of an in-building RF coverage solution that guarantees a minimum RF signal level of -95 dBm throughout the entire facility and attached structures under the conditions described in this document.
- Sealed floor plans showing radio coverage for critical and general areas using industry standard radio frequency computer generated propagation modeling.

- Notation that the system is upgradable for frequency band coverage changes including at a minimum both 700/800 MHz.
- Obtain the necessary building permits.
- Record all appropriate signal levels after the system implementation as previously detailed. Prepare and submit to Hillsborough County the “Before and After” floor plans showing signal levels.
- Address any in-building RF coverage issue discovered during the Acceptance Test.
- Address any reported RF interference issue related to the new DAS installation.
- Provide the Building Owner & HCSO with project documentation including but not limited to “As-built” documentation, in soft copy format (e.g, PDF), system documents, technical manuals, Return Loss or VSWR readings of the RF lines, diagrams showing equipment placement and routing for antennas, coaxial cables, fiber optics interconnections and AC power.

Building Owner Responsibilities

- Keep record of the project documentation including but not limited to a signed CORCC and “As-built” documentation, in soft copy format (e.g., PDF), system documents, technical manuals, Return Loss or VSWR readings of the RF lines, diagrams showing equipment placement and routing for antennas, coaxial cables, fiber optics interconnections and AC power.
- Have in place a service contract with a qualified RF Vendor for technical maintenance, repair (including all components of the system), operation and troubleshooting in the event of radio RF interference involving the in-building RF radio coverage solution {Maximum 4- hour response time}.
- The Building Owner shall provide the contact information of the System Maintenance Vendor to the Hillsborough County Sheriff’s Office, so this entity can work directly with the Vendor in case of troubleshooting due to an interference event.
- Provide the HCFR and/or HCSO with continuous access to the facility for purposes of testing of the Public Safety radio signal & disabling the DAS system at any time due to HCSO system interference without prior notice to access the BDA system.

Sample Provisional Retransmission Authorization

HILLSBOROUGH COUNTY SHERIFF'S OFFICE, FLORIDA **PROVISIONAL 700/800 MHz RETRANSMISSION AUTHORIZATION**

Hillsborough County Sheriff's Office, Florida (HCSO) hereby grants provisional authorization to _____ [name of system operator] (Operator) to operate a Two-Way Radio Communications Enhancement System (the System) on 700/800 MHz frequencies licensed to HCSO by the Federal Communications Commission (FCC) under call signs WQNM806, WQPS818, WQVH304, WQRG242, WPCW643, WPDV262, WPHE897, WPMB935, WQBY646, WQLZ361, and WQPK525 at the following location:

Site Name: _____
Site Address: _____
Latitude: _____ Longitude: _____
FCC Booster ID: _____
Site Contact: _____
Phone #: _____ Email: _____

This Authorization is subject to the following conditions:

1. This Provisional Retransmission Authorization is issued for the purposes of system installation, optimization, testing and commissioning and is valid for one year from date of issuance. Upon successful completion of final inspection and testing, a Final Retransmission Authorization will be issued. The Final Retransmission Authorization is valid for five years from date of issuance, and will be renewed upon request when proof of successful NFPA72-2013 compliant annual testing is provided.
2. The System shall not cause interference to radio systems or equipment operated by HCSO, or any other FCC licensee.
3. Operator shall promptly resolve any interference that occurs to radio systems or equipment operated by HCSO, or any other FCC licensee, up to and including deactivation of the System, if necessary, until such time that the interference is corrected.
4. Operator shall provide access to the System for inspection upon request by HCSO or the FCC.
5. A separate Provisional Authorization shall be obtained for each headend location used in the system design and posted conspicuously with the headend equipment.
6. HCSO reserves the right to conduct an initial donor site desense test when the System is activated for the first time.
7. HCSO, as FCC licensee for its frequencies, reserves the right to terminate this Provisional Authorization at its sole discretion.

Hillsborough County Sheriff's Office Date: _____

Revised March 29, 2018

Sample Retransmission Application

Radio Communication Enhancement System
Retransmission Application

City of Tampa, Florida
Technology and Innovation

COMPLETE SEPARATE APPLICATIONS FOR EACH HEADEND IN SYSTEM DESIGN. SEE INSTRUCTIONS AND CHECKLIST ON SECOND PAGE.	
1. SITE INFORMATION	
Site Name:	
Site Address:	
Low Voltage Permit Number (Issued by City of Tampa Construction Services Division):	
Site Description (include type of construction, number of floors, total interior square footage):	
Site Latitude and Longitude:	
BDA Manufacturer and Model:	Class:
BDA Headend Location (room number, etc.):	
Number of Line Amplifiers:	Line Amplifier Manufacturer and Model:
Type of System: Single carrier, County 800MHz only Multiple carrier, neutral host Other (describe below)	
2. OWNER CONTACT INFORMATION	
Owner:	
Owner Address:	
Point of Contact:	Email:
Work Phone:	Mobile Phone:
3. SITE ACCESS OR TECHNICAL CONTACT INFORMATION	
Name:	Email:
Company:	
Address:	
Work Phone:	Mobile Phone:
3. SYSTEM INTEGRATOR/INSTALLER/MAINTAINER	
Name:	Email:
Company:	
Address:	
Work Phone:	Mobile Phone:
5. PREPARER SIGNATURE AND DATE	
Signature:	Date:
Print name and title:	

System Technical Data

HCSO operates four (4) radio systems that cover Hillsborough County & the City of Tampa as applicable, a seven site, twenty-channel 800 MHz analog/digital simulcast trunked radio system (West System), a ten site, fifteen-channel 800 MHz analog/digital simulcast trunked radio system (East System), a nine (9)site, ten-channel 700 / 800MHz P25 digital simulcast trunked radio system (P25 700 / 800 East System) & a nine (9) site, ten-channel 700 / 800 MHz P25 digital simulcast trunked radio system (P25 700 / 800 West System) for first responders communications. The following system technical data is provided to assist two-way radio communications enhancement system designers.

(Remainder of page left blank intentionally)

Table 1 - EDACS System 800MHz Frequencies East & West

East System EDACS Simulcast System Repeaters		
Channel	Transmit Frequency	Receive Frequency
1	851.3750	806.3750
2	851.7000	806.7000
3	852.9125	807.9125
4	853.2750	808.2750
5	853.6000	808.6000
6	853.8250	808.8250
7	851.1250	806.1250
8	852.5500	807.5500
9	852.8000	807.8000
10	852.6500	807.6500
11	851.5625	806.5625
12	851.8250	806.8250
13	852.3125	807.3125
14	853.2500	808.2500
15	853.5750	808.5750
West System EDACS Simulcast System Repeaters		
Channel	Transmit Frequency	Receive Frequency
1	851.2250	806.2250
2	851.7500	806.7500
3	852.0625	807.0625
4	853.5250	808.5250
5	853.7125	808.7125
6	853.7375	808.7375
7	853.1250	808.1250
8	851.2500	806.2500
9	851.4125	806.4125
10	851.7250	806.7250
11	852.0375	807.0375
12	853.1000	808.1000
13	853.3000	808.3000
14	853.6875	808.6875
15	852.4000	807.4000
16	851.0500	806.0500
17	851.8000	806.8000
18	852.6875	807.6875
19	852.7250	807.7250
20	853.3500	808.3500

P25 West System Frequencies

700MHz / 800MHz West P25 Simulcast System Repeaters		
Channel	Transmit Frequency	Receive Frequency
1	769.28125	799.28125
2	769.80625	799.80625
3	770.33125	800.33125
4	771.00625	801.00625
5	771.73125	801.73125
6	772.23125	802.23125
7	772.90625	802.90625
8	773.48125	803.48125
9	773.98125	803.98125
10	774.63125	804.63125

P25 East System Frequencies

700MHz / 800MHz East P25 Simulcast System Repeaters		
Channel	Transmit Frequency	Receive Frequency
1	769.55625	799.55625
2	770.58125	800.58125
3	771.30625	801.30625
4	771.75625	801.75625
5	771.98125	801.98125
6	772.48125	802.23125
7	772.90625	802.48125
8	773.23125	803.23125
9	773.38125	804.38125
10	774.89375	804.89375

Appendix A – 47CFR90.219, FCC rules governing use of Signal Boosters

§90.219 Use of signal boosters.

This section contains technical and operational rules allowing the use of signal boosters in the Private Land Mobile Radio Services (PLMRS). Rules for signal booster operation in the Commercial Mobile Radio Services under part 90 are found in §20.21 of this chapter.

(a) *Definitions.* The definitions in this paragraph apply only to the rules in this section.

Class A signal booster. A signal booster designed to retransmit signals on one or more specific channels. A signal booster is deemed to be a Class A signal booster if none of its passbands exceed 75 kHz.

Class B signal booster. A signal booster designed to retransmit any signals within a wide frequency band. A signal booster is deemed to be a Class B signal booster if it has a passband that exceeds 75 kHz.

Coverage area of a PLMRS station. All locations within the normal reliable operating range (service contour) of a PLMRS station.

Deploy a signal booster. Install and/or initially adjust a signal booster.

Distributed Antenna System (DAS). A network of spatially separated antenna nodes connected to a common source via a transport medium that provides wireless service within a geographic area or structure.

Operate a signal booster. Maintain operational control over, and responsibility for the proper functioning of, a signal booster.

Signal booster. A device or system that automatically receives, amplifies, and retransmits signals from wireless stations into and out of building interiors, tunnels, shielded outdoor areas and other locations where these signals would otherwise be too weak for reliable communications. Signal booster systems may contain both Class A and Class B signal boosters as components.

(b) *Authority to operate.* PLMRS licensees for stations operating on assigned channels higher than 150 MHz may operate signal boosters, limited to the service band for which they are authorized, as needed anywhere within the PLMRS stations' service contour, but may not extend the stations' service contour.

(1) PLMRS licensees may also consent to operation of signal boosters by non-licensees (such as a building owner or a signal booster installation contractor) within their service contour and across their applicable frequencies but must maintain a reasonable level of control over these operations in order to resolve interference problems.

- (i) Non-licensees seeking to operate signal boosters must obtain the express consent of the licensee(s) of the frequencies for which the device or system is intended to amplify. The consent must be maintained in a recordable format that can be presented to an FCC representative or other relevant licensee investigating interference.
 - (ii) Consent is not required from third party (unintended) licensees whose signals are incidentally retransmitted. However, signal booster operation is on a non-interference basis and operations may be required to cease or alter the operating parameters due to a request from an FCC representative or a licensee's request to resolve interference.
- (2) [Reserved]
- (c) *Licensee responsibility; interference.* PLMRS licensees that operate signal boosters are responsible for their proper operation and are responsible for correcting any harmful interference that signal booster operation may cause to other licensed communications services. Normal co-channel transmissions are not considered to be harmful interference. Licensees are required to resolve interference problems pursuant to §90.173(b). Licensees shall act in good faith regarding the operation of signal boosters and in the resolution of interference due to signal booster operation. Licensees who are unable to determine the location or cause of signal booster interference may seek assistance from the FCC to resolve such problems.
 - (d) *Deployment rules.* Deployment of signal boosters must be carried out in accordance with the rules in this paragraph.
 - (1) Signal boosters may be used to improve coverage in weak signal areas only.
 - (2) Signal boosters must not be used to extend PLMRS stations' normal operating range.
 - (3) Signal boosters must be deployed such that the radiated power of each retransmitted channel, on the forward link and on the reverse link, does not exceed 5 Watts effective radiated power (ERP).
 - (4) Class B signal boosters may be deployed only at fixed locations; mobile operation of Class B signal boosters is prohibited after November 1, 2014.
 - (5) Class B signal booster installations must be registered in the FCC signal booster database that can be accessed at the following URL:
www.fcc.gov/signal-boosters/registration.
 - (6) Good engineering practice must be used in regard to the radiation of intermodulation products and noise, such that interference to licensed communications systems is avoided. In the event of harmful interference caused by any given deployment, the FCC may require additional attenuation or filtering of the emissions and/or noise from signal boosters or signal booster systems, as necessary to eliminate the interference.

- (i) In general, the ERP of intermodulation products should not exceed –30 dBm in 10 kHz measurement bandwidth.
 - (ii) In general, the ERP of noise within the passband should not exceed –43 dBm in 10 kHz measurement bandwidth.
 - (iii) In general, the ERP of noise on spectrum more than 1 MHz outside of the passband should not exceed –70 dBm in a 10 kHz measurement bandwidth.
- (7) Signal booster passbands are limited to the service band or bands for which the operator is authorized. In general, signal boosters should utilize the minimum passband that is sufficient to accomplish the purpose. Except for distributed antenna systems (DAS) installed in buildings, the passband of a Class B booster should not encompass both commercial services (such as ESMR and Cellular Radiotelephone) and part 90 Land Mobile and Public Safety Services.
- (e) *Device Specifications.* In addition to the general rules for equipment certification in §90.203(a) (2) and part 2, subpart J of this chapter, a signal booster must also meet the rules in this paragraph.
- (1) The output power capability of a signal booster must be designed for deployments providing a radiated power not exceeding 5 Watts ERP for each retransmitted channel.
 - (2) The noise figure of a signal booster must not exceed 9 dB in either direction.
 - (3) Spurious emissions from a signal booster must not exceed –13 dBm within any 100 kHz measurement bandwidth.
 - (4) A signal booster must be designed such that all signals that it retransmits meet the following requirements:
 - (i) The signals are retransmitted on the same channels as received. Minor departures from the exact provider or reference frequencies of the input signals are allowed, *provided that* the retransmitted signals meet the requirements of §90.213.
 - (ii) There is no change in the occupied bandwidth of the retransmitted signals.
 - (iii) The retransmitted signals continue to meet the unwanted emissions limits of §90.210 applicable to the corresponding received signals (assuming that these received signals meet the applicable unwanted emissions limits by a reasonable margin).
 - (5) On or after March 1, 2014, a signal booster must be labeled to indicate whether it is a Class A or Class B device, and the label must include the following advisory

- (1) In on-line point-of-sale marketing materials,
- (2) In any print or on-line owner's manual and installation instructions,
- (3) On the outside packaging of the device, and
- (4) On a label affixed to the device:

“WARNING. This is NOT a CONSUMER device. It is designed for installation by FCC LICENSEES and QUALIFIED INSTALLERS. You MUST have an FCC LICENSE or express consent of an FCC Licensee to operate this device. You MUST register Class B signal boosters (as defined in 47 CFR 90.219) online at www.fcc.gov/signal-boosters/registration. Unauthorized use may result in significant forfeiture penalties, including penalties in excess of \$100,000 for each continuing violation.”

[78 FR 21564, Apr. 12, 2013]

Appendix B - Article 800 • Communications Circuits 800.179 (National Electrical Code Handbook 2014)

TABLE 800.179 Cable Markings

Cable Marking	Type
CMP	Communications plenum cable
CMR	Communications riser cable
CMG	Communications general-purpose cable
CM	Communications general-purpose cable
CMX	Communications cable, limited use

CMUC Undercarpet communications wire and cable

Informational Note: Cable types are listed in descending order of fire resistance rating.

Informational Note: One method of defining a cable that is low-smoke producing cable and fire-resistant cable is that the cable exhibits a maximum peak optical density of 0.50 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.52 m (5 ft) or less when tested in accordance with NFPA 262-2011, Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces.

See the commentary following the informational note to 725.179(A).

(B) Type CMR. Type CMR communications riser cables shall be listed as being suitable for use in a vertical run in a shaft or from floor to floor and shall also be listed as having fire-resistant characteristics capable of preventing the carrying of fire from floor to floor.

Informational Note: One method of defining fire-resistant characteristics capable of preventing the carrying of fire from floor to floor is that the cables pass the requirements of ANSI/UL 1666-2011, Standard Test for Flame Propagation Height of Electrical and Optical Fiber Cable Installed Vertically in Shafts.

See the commentary following the informational note to 725.179(B).

(C) Type CMG. Type CMG general-purpose communications cables shall be listed as being suitable for general-purpose communications use, with the exception of risers and plenums, and shall also be listed as being resistant to the spread of fire.

Informational Note: One method of defining resistant to the spread of fire is for the damage (char length) not to exceed 1.5 m (4 ft 11 in.) when performing the CSA

"Vertical Flame Test — Cables in Cable Trays," as described in CSA C22.2 No. 0.3-M-2001, Test Methods for Electrical Wires and Cables.

See the commentary following the informational note to 725.179(C).

(D) Type CM. Type CM communications cables shall be listed as being suitable for general-purpose communications use, with the exception of risers and plenums, and shall also be listed as being resistant to the spread of fire.

Informational Note: One method of defining resistant to the spread of fire is that the cables do not spread fire to the top of the tray in the 'SUL Flame Exposure, Vertical Flame Tray Test' in ANSI/UL 1685-2011, Standard for Safety for Vertical-Tray Fire Propagation and Smoke-Release Test for Electrical and Optical Fiber Cables. The smoke measurements in the test method are not applicable.

Another method of defining resistant to the spread of fire is for the damage (char length) not to exceed 1.5 m (4 ft 11 in.) when performing the CSA "Vertical Flame Test— Cables in Cable Trays," as described in CSA C22.2 No. 0.3-M-2001, Test Methods for Electrical Wires and Cables.

See the commentary following the informational note to 725.1790.

(E) Type CMX. Type CMX limited-use communications cables shall be listed as being suitable for use in dwellings and for use in raceway and shall also be listed as being resistant to flame spread.

Informational Note: One method of determining that cable is resistant to flame spread is by testing the cable to the VW-I (vertical-wire) flame test in ANSI/UL 1581-2011, Reference Standard for Electrical Wires, Cables and Flexible Cords.

(F) Type CMUC Undercarpet Wires and Cables. Type CMUC undercarpet communications wires and cables shall be listed as being suitable for undercarpet use and shall also be listed as being resistant to flame spread.

Informational Note: One method of determining that cable is resistant to flame spread is by testing the cable to the VW-I (vertical-wire) flame test in ANSI/UL 1581-2011, Reference Standard for Electrical Wires, Cables and Flexible Cords.

(G) Circuit Integrity (CI) Cable or Electrical Circuit Protective System. Cables that are used for survivability of critical circuits under fire conditions shall be listed and meet either or (2) as follows:

Informational Note: The listing organization provides information for circuit integrity (CI) cable and electrical circuit protective systems, including installation requirements required to maintain the fire rating.

- (1) Circuit Integrity (CI) Cables. Circuit integrity (CI) cables specified in 800.179(A) through (E), and used for survivability of critical circuits, shall have an additional classification using the suffix "CI." In order to maintain its listed fire rating, circuit integrity (CI) cable shall only be installed in free air.

Informational Note: One method of defining circuit integrity (CD cable is by establishing a minimum 2-hour fire resistance rating for the cable when tested in accordance with ANSI/UL 2 196-2006, Standard for Tests of Fire-Resistive Cable.

- (2) Fire-Resistive Cables. Cables specified in 800.179(A) through (E) and 800.179(G)(1), that are part of an electrical circuit protective system, shall be fire-resistive cable identified with the protective system number on the product, or on the smallest unit container in which the product is packaged, and shall be installed in accordance with the listing of the protective system.

Informational Note No. I: One method of defining an electrical circuit protective system is by establishing a minimum 2-hour fire resistance rating for the system when tested in accordance with UL Subject 1724, Outline of Investigation for Fire Tests for Electrical Circuit Protective Systems.

Informational Note No. 2: The listing organization provides information for electrical circuit protective systems (FHIT), including installation requirements for maintaining the fire rating.

(H) Communications Wires. Communications wires, such as distributing frame wire and jumper wire, shall be listed as being resistant to the spread of fire.

Informational Note: One method of defining resistant to the spread of fire is that the cables do not spread fire to the top of the tray in the "UL Flame Exposure, Vertical Flame Tray Test" in ANSI/XUL 1685-2010, Standard for Safety for Vertical-Tray Fire-Propagation and Smoke-Release Test for Electrical and Optical-Fiber Cables. The smoke measurements in the test method are not applicable.

Another method of defining resistant to the spread of fire is for the damage (char length) not to exceed 1.5 m (4 ft 11 in.) when performing the CSA "Vertical Flame Test—Cables in Cable Trays," as described in CSA C22.2 No. 0.3-M-2001, Test Methods for Electrical Wires and Cables.

(I) Hybrid Power and Communications Cables. Listed hybrid power and communications cables shall be permitted where the power cable is a listed Type NM or NM-B, conforming to the provisions of Part III of Article 334, and the communications cable is a listed Type CM, the jackets on the listed NM or NM-B, and listed CM cables are rated for 600 volts minimum, and the hybrid cable is listed as being resistant to the spread of fire.

Informational Note: One method of defining resistant to the spread of fire is that the cables do not spread fire to the top of the tray in the "UL Flame Exposure, Vertical Flame Tray Test" in ANSI/UL 1685-2010, Standard for Safety for Vertical-Tray Fire Propagation and Smoke-Release Test for Electrical and Optical Fiber Cables. The smoke measurements in the test method are not applicable.

Another method of defining resistant to the spread of fire is for the damage (char length) not to exceed 1.5 m (4 ft 11 in.) when performing the CSA "Vertical Flame Test — Cables in Cable Trays," as described in CSA 02.2 No. 0.3-M-2001, Test Methods for Electrical Wires and Cables.

800.180 Grounding Devices

Where bonding or grounding is required, devices used to connect a shield, a sheath, or non—current-carrying metallic members of a cable to a bonding conductor or grounding electrode conductor shall be listed or be part of listed equipment.

800.182 Communications Raceways and Cable Routing Assemblies

Communications raceways and cable routing assemblies shall be listed in accordance with 800.182(A) through (C).

Informational Note: For information on listing requirements for both communications raceways and cable routing assemblies, see ANSI/UL 2024-4-2011, Signaling, Optical Fiber and Communications Raceways and Cable Routing Assemblies.

(A) Plenum Communications Raceways and Plenum Cable Routing Assemblies. Plenum communications raceways and plenum cable routing assemblies shall be listed as having adequate fire-resistant and low-smoke producing characteristics.

(B) Riser Communications Raceways and Riser Cable Routing Assemblies. Riser communications raceways and routing assemblies shall be listed as having adequate fire-resistant characteristics capable of preventing the carrying of fire from floor to floor.

(C) General-Purpose Communications Raceways and General Purpose Cable Routing Assemblies. General-purpose communications raceways and general-purpose cable routing assemblies shall be listed as being resistant to the spread of fire.

The application of communications raceway and cable routing assemblies are summarized in Tables 800.154(b) and (c). The installation location will dictate the type of cable permitted within the raceway or assembly as summarized in Table 800.154(a).

A raceway marked "plenum" is suitable for use in ducts, plenums, or other spaces used for environmental air in accordance with 800.154. These are identified by a marking on its surface or on a marker tape indicating "plenum." A "plenum" raceway assembly is also suitable for installation in risers, for general purpose use, and for dwellings.

A raceway or routing assembly marked "riser" is suitable for installation in risers in accordance with 800.154. These are identified by a marking on its surface or on a marker tape indicating "riser." A "riser" raceway or routing assembly is also suitable for general-purpose use and for dwellings.

A raceway or routing assembly marked "general purpose" is suitable for installation in general-purpose areas in accordance with 800.154 and for dwellings.

Pliable raceway is raceway that can be bent by hand without the use of tools. The smallest radius of the curve of the inner edge of any bend to which the raceway can be bent without cracking either on the outer surface or internally is not less $2 \frac{1}{2}$ times the outside diameter of the raceway.

Informational Note: The general term grounding conductor as previously used in this article is replaced by either the term bonding conductor or the term grounding electrode conductor (GEC) where applicable, to more accurately reflect the function of the conductor.

Appendix C - Retransmission Application

Hillsborough County Fire Rescue		
Radio Communication Enhancement System		
Retransmission Application		
<i>Complete separate applications for each headend in system design.</i>		
1. Site Information		
Site Name:		
Site Address:		
Low Voltage Permit Number (FA):		
Site Description (include type of construction, number of floors, total interior square footage):		
Site Latitude and Longitude:		
BDA Manufacturer and Model:	Class:	
BDA Headend Location (Room #):		
Number of Line Amplifiers:	Line Amplifier Manufacturer and Model:	
Type of System: Single Carrier, County 800MHz only / Multiple Carrier, Neutral host / Other (Describe below):		
2. Owner Contact Information		
Owner Name:		
Owner Address:		
Point of Contact Name:	POC Email:	
Work Phone:	Cell Phone:	
3. Site Access or Technical Contact Information		
Name:	Email:	
Company:		
Address:		
Work Phone:	Cell Phone:	
4. System Integrator / Installer / Maintainer		
Name:		
Company:		
Address:		
Work Phone:	Cell Phone:	
5. Preparer Signature and Date		
Signature:	Date:	
Printed Name and Title:		

Appendix D - Provisional Retransmission Authorization

HILLSBOROUGH COUNTY SHERIFF'S OFFICE, FLORIDA ***PROVISIONAL* 700/800 MHz RETRANSMISSION AUTHORIZATION**

Hillsborough County Sheriff's Office, Florida (HCSO) hereby grants provisional authorization to _____ *[name of system operator]* (Operator) to operate a Two-Way Radio Communications Enhancement System (the System) on 700/800 MHz frequencies licensed to HCSO by the Federal Communications Commission (FCC) under call signs WQNM806, WQPS818, WQVH304, WQRG242, WPCW643, WPDV262, WPHE897, WPMB935, WQBY646, WQLZ361, and WQPK525 at the following location:

Site Name: _____

Site Address: _____

Latitude: _____

Longitude: _____

FCC Booster ID: _____

Site Contact: _____

Phone #: _____

Email: _____

This Authorization is subject to the following conditions:

1. This Provisional Retransmission Authorization is issued for the purposes of system installation, optimization, testing and commissioning and is valid for one year from date of issuance. Upon successful completion of final inspection and testing, a Final Retransmission Authorization will be issued. The Final Retransmission Authorization is valid for five years from date of issuance, and will be renewed upon request when proof of successful NFPA72-2013 compliant annual testing is provided.
2. The System shall not cause interference to radio systems or equipment operated by HCSO, or any other FCC licensee.
3. Operator shall promptly resolve any interference that occurs to radio systems or equipment operated by HCSO, or any other FCC licensee, up to and including deactivation of the System, if necessary, until such time that the interference is corrected.
4. Operator shall provide access to the System for inspection upon request by HCSO or the FCC.
5. A separate Provisional Authorization shall be obtained for each headend location used in the system design and posted conspicuously with the headend equipment.
6. HCSO reserves the right to conduct an initial donor site desense test when the System is activated for the first time.
7. HCSO, as FCC licensee for its frequencies, reserves the right to terminate this Provisional Authorization at its sole discretion.

Date:

Hillsborough County Sheriff's Office

Appendix E - Retransmission Authorization

HILLSBOROUGH COUNTY SHERIFF'S OFFICE, FLORIDA 700/800 MHz RETRANSMISSION AUTHORIZATION

Hillsborough County Sheriff's Office, Florida (HCSO) hereby grants authorization to _____ [name of system operator] (Operator) to operate a Two-Way Radio Communications Enhancement System (the System) on 700/800 MHz frequencies licensed to HCSO by the Federal Communications Commission (FCC) under call signs WQNM806, WQPS818, WQVH304, WQRG242, WPCW643, WPDV262, WPHE897, WPMB935, WQBY646, WQLZ361, and WQPK525 at the following location:

Site Name: _____
Site Address: _____
Latitude: _____ Longitude: _____
FCC Booster ID: _____
Site Contact: _____
Phone #: _____ Email: _____

This Authorization is subject to the following conditions:

1. The Retransmission Authorization is valid for five years from date of issuance, and will be renewed upon request, when an application for renewal and proof of successful NFPA72-2013 compliant annual testing are provided. Renewal forms and instructions can be obtained by emailing smitchel@hcsotampa.fl.us or calling (813) 247-0080.
2. The System shall be operated, maintained and tested annually in accordance with manufacturer's instructions, FCC rules and regulations, and the requirements of NFPA 72, National Fire Alarm and Signaling Code, 2013 Edition.
3. The System shall not cause interference to radio systems or equipment operated by HCSO, or any other FCC licensee.
4. Operator shall promptly resolve any interference that occurs to radio systems or equipment operated by HCSO, or any other FCC licensee, up to and including deactivation of the System, if necessary, until such time that the interference is corrected.
5. In the event of an outage of the System, Operator shall notify the City of Tampa Fire Marshal in accordance with the regulations, policies and procedures for reporting any fire alarm/fire safety system outage.
6. Operator shall provide access to the System for inspection upon request by HCSO or the FCC.
7. A separate Retransmission Authorization shall be obtained for each headend location used in the system design and posted conspicuously with the headend equipment.
8. HCSO, as FCC licensee for its frequencies, reserves the right to terminate this Authorization at its sole discretion.

Hillsborough County Sheriff's Office Date: _____

Revised March 29, 2018